



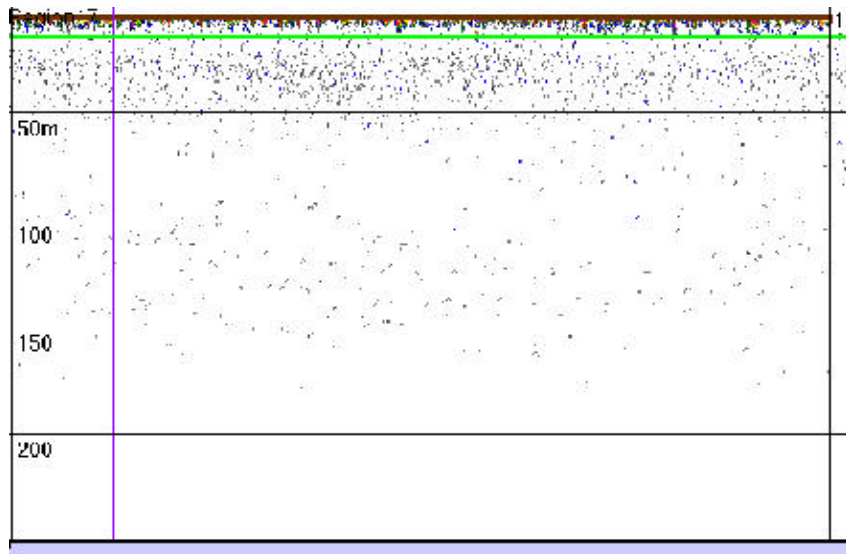

a)

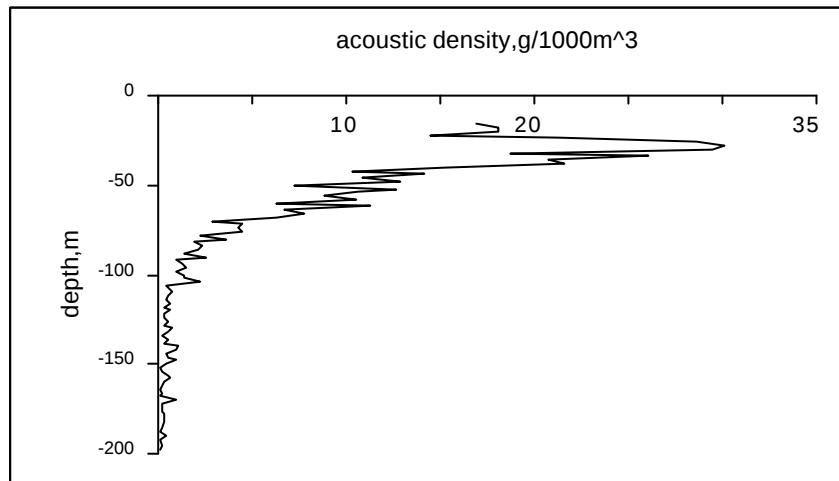

b)

Fig.9. Krill spatial distribution patterns. Night-time trawl station, example 13 in Table 2.
 mean net density - 1638.19 g/1000m³; mean acoustic density- 4.3g/1000m³
 a) Acoustic echo chart along the trawl track.
 b) vertical distribution of krill acoustic density when trawling